


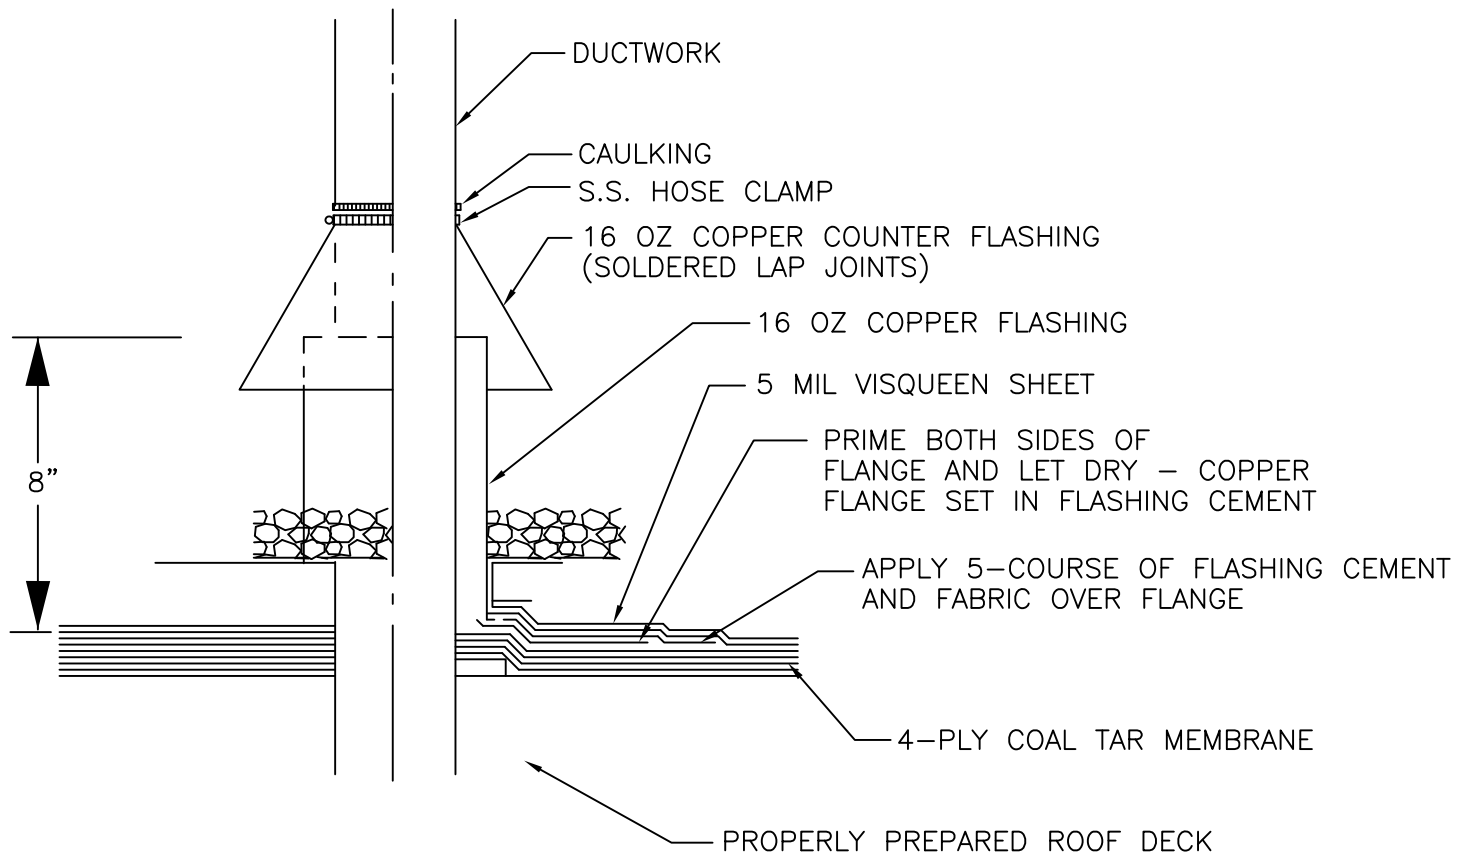

NOTE: ALL JOINTS SHALL BE SOLDERED.

DUCT THROUGH ROOF FLASHING

SCALE: NONE

DUCT THROUGH ROOF FLASHING

Typical Detail

CS_STD_ARC_075500_DUCT_THRU_INVERTED_ROOF.dwg

DATE
2/5/10

DRAWN

REVISION
7/13/16
RLANDRUM

DETAIL NO.
XXXXXX-XX

SHEET



OF ONE