etail


 \triangle

Typical

REVISION 7/13/16 RLANDRUM

DETAIL NO.



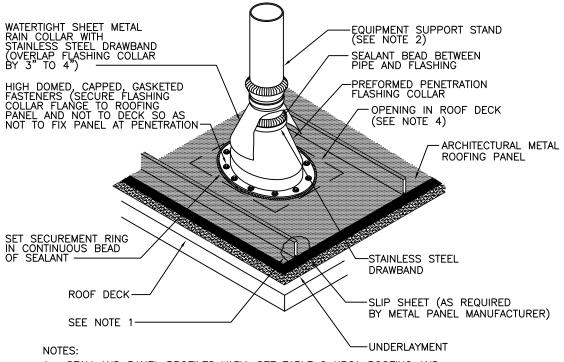

- SEAM AND PANEL PROFILES VARY, SEE TABLE 2 NRCA ROOFING AND WATERPROOFING MANUAL FOURTH EDITION DESIGN PLACEMENT OF PENETRATION SHOULD ELIMINATE THE POSSIBILITY OF FLASHING FLANGES INTERFERING WITH PANEL SEAMS. IF FIELD PANELS OVERLAP AT THE PENETRATION, ATTACHMENT OF THE DOWNSLOPE PANEL, ALONG ITS UPSLOPE END, MAY BE NECESSARY. CUT OVERSIZE HOLE IN ROOF DECK TO ALLOW FOR THERMAL MOVEMENT. EQUIPMENT SUPPORT STAND SHALL HAVE A MINIMUM 12 INCHES CLEARANCE ON ALL SIDES FROM WALLS, CURBS AND OTHER PROJECTIONS TO FACILITATE PROPER FLASHING.

SUPPORT STAND PIPE FLASHING DETAIL NO SCALE