


**NOTES:**


1. DRAIN DOWN VALVES SHALL BE 2" FOR MAINS GREATER THAN 2". ALL MAINS THAT ARE 2" OR LESS SHALL HAVE FULL LINE SIZE BLOW DOWN VALVES

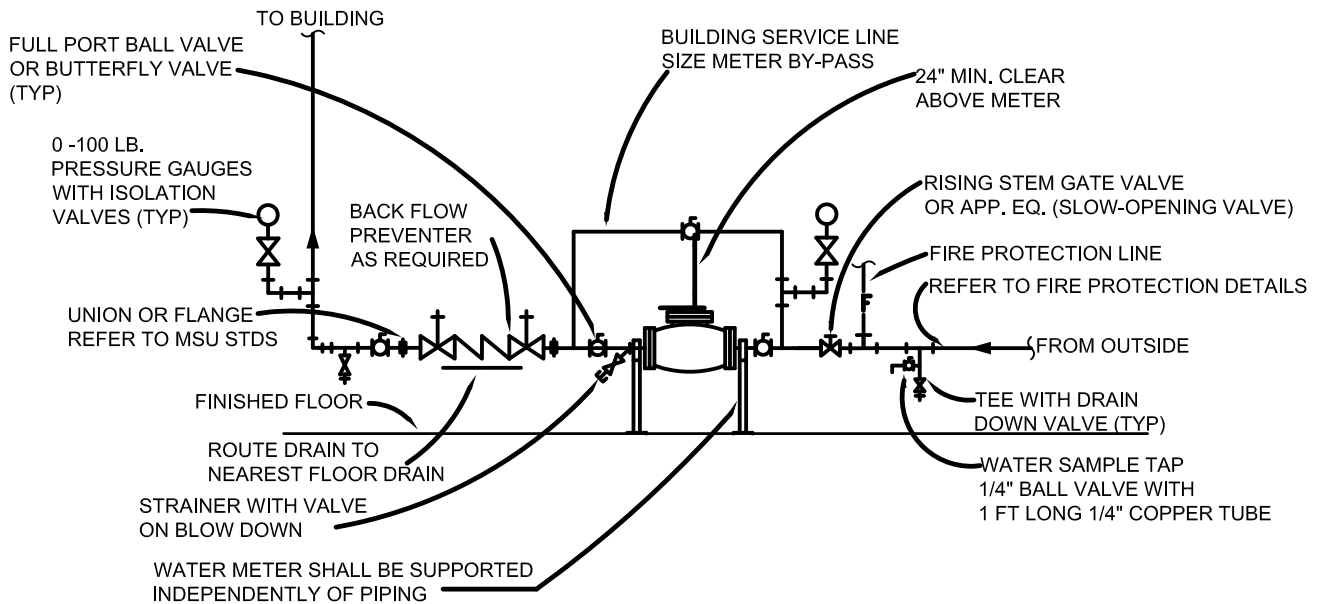

**WATER SERVICE PIPING DIAGRAM**

NO SCALE

CS\_STD\_MEC\_221116\_WATER\_SERVICE.dwg

<b>MICHIGAN STATE UNIVERSITY</b>   Infrastructure Planning and Facilities	WATER SERVICE PIPING DIAGRAM		DATE	DETAIL NO.	SHEET  OF ONE
			6/9/8	22116-01	
			DRAWN	REVISION	
			EAS	7/11/16	
				RLANDRUM	