


NOTES:

1. LOCATE BFP BETWEEN 12" AND 60" FROM FLOOR UNLESS INDICATED OTHERWISE

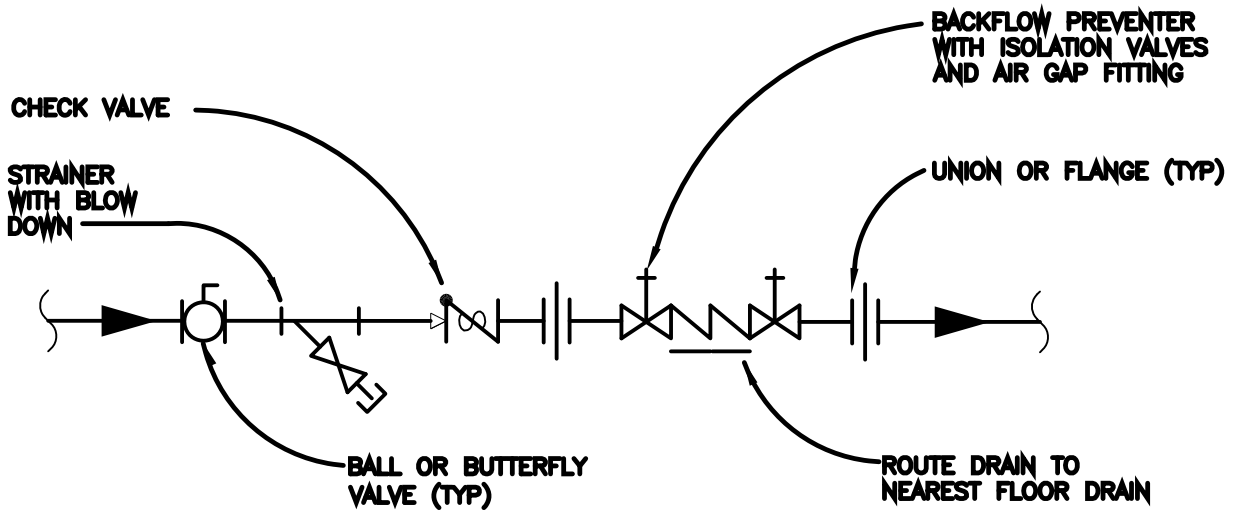

BACKFLOW PREVENTER PIPING DIAGRAM
NO SCALE

CS_STD_MEC_221119_BFP.dwg

