

**DESIGNERS NOTES:**


- CONFIRM LOCATION OF SAFE WASTE ON DRAWINGS
- COORD. REQ'D PAD HEIGHT WITH ARCH TRADES TO ENSURE TRAP ABOVE FINISHED FLOOR WITH PROPER SLOPE FOR DRAINAGE

**NOTES:**

FOR DRAW THROUGH UNIT DIM "A"=1/2 OF DIM "B"  
 DIM "B"=FAN SUCTION STATIC PRESS. PLUS 2 IN.

FOR BLOW THROUGH UNIT DIM "A"=FAN DISCHARGE  
 STATIC PRESS. PLUS 2 IN. DIM "B"=2 IN. MIN.

REFER TO EQUIPMENT SCHEDULE FOR SUCTION OR  
 DISCHARGE STATIC PRESSURE

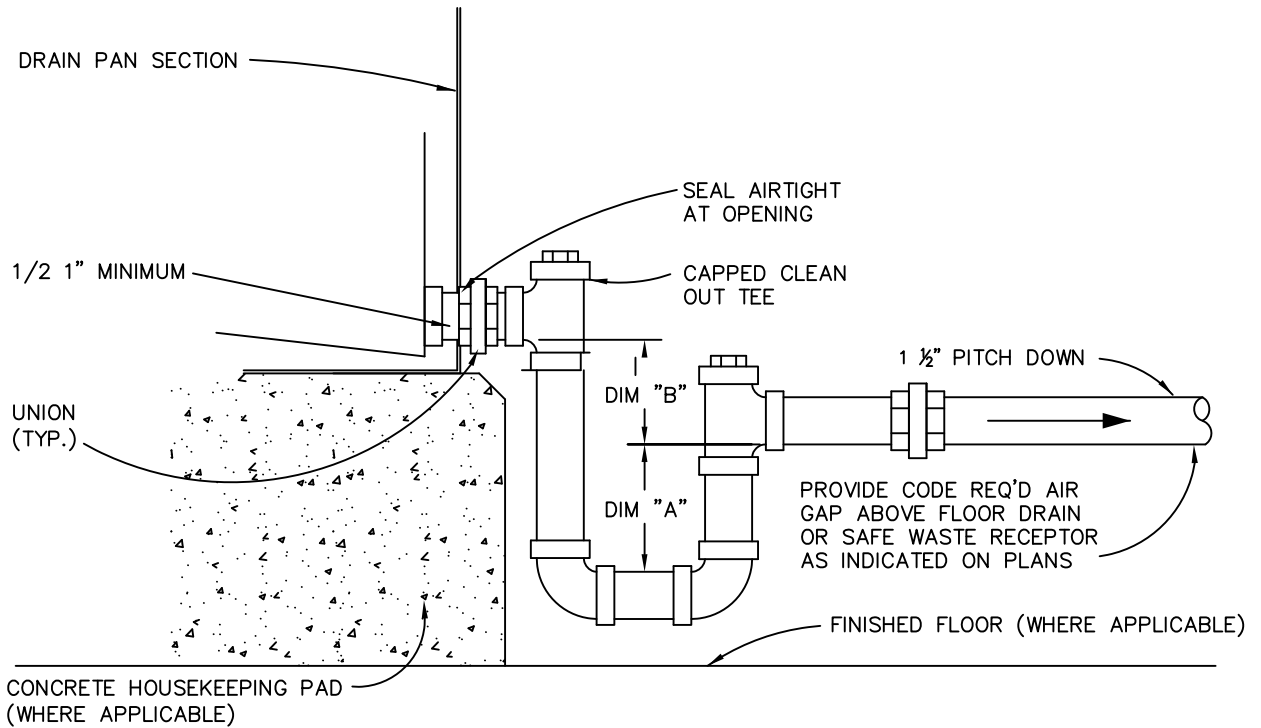

## DRAIN PAN TRAP DETAIL

NO SCALE

**NOTES:**

1. APPLICABLE FOR ALL COOLING COILS, HUMIDIFIER SECTIONS, AND FOR AHU INTAKE SECTION ON 100% OUTSIDE AIR UNITS, ETC. CAP OTHER UNIT DRAIN OPENINGS WITH REMOVABLE CAPS.
2. IF FLOOR DRAIN USED, COVER SHALL REMAIN READILY ACCESSIBLE.

CS\_STD\_MEC\_232113\_DRAIN\_PAN\_TRAP.dwg

<b>MICHIGAN STATE UNIVERSITY</b>   Infrastructure Planning and Facilities	DRAIN PAN TRAP DETAIL		DATE 8/30/16	DETAIL NO. 232113-01	SHEET  OF ONE
	DRAWN		REVISION 7/11/16 RLANDRUM		